



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
Miami, Florida 33175-2474  
T (786) 315-2590 F (786) 315-2599

**NOTICE OF ACCEPTANCE (NOA)**

[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

**Green-Span Profiles, L.P.**  
21200 FM 362  
Waller, TX 77484

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER- Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: "IWP Series" Insulated Steel Wall Panel**

**APPROVAL DOCUMENT:** Drawing No. 438-0086T-13, titled "IWP Series", sheets 1 through 14 of 14, prepared by Brian N. Jaks, P.E., dated April 11, 2019, signed and sealed by Brian N. Jaks, P.E., on April 12, 2019, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each panel shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA #15-0204.02 and consists of this page 1, evidence submitted pages E-1 and E-2 as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**



*Helmy A. Makar*  
05/16/2019

NOA No. 19-0417.03  
Expiration Date: 01/14/2021  
Approval Date: 05/16/2019  
Page 1

**Green-Span Profiles, L.P.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 15-0204.02**

**A. DRAWINGS**

1. *Drawing No. 438-0086T-13, titled "IWP Series", sheets 1 through 14 of 14, prepared by Brian N. Jaks, P.E., dated May 29, 2015, signed and sealed by Brian N. Jaks, P.E., on June 10, 2015.*

**B. TESTS**

1. *Test report on Large Missile Impact Test per TAS 201, Cyclic Wind Pressure Test per TAS 203, and Uniform Static Air Pressure Test per TAS 202 on Exterior Steel Insulated Wall Panel, prepared by Force Engineering & Testing, Inc., Report No. 438-0086T-13, dated 12/09/2013, signed by Brandon Jasek, P.E.*
2. *Test report on Large Missile Impact Test per TAS 201, Cyclic Wind Pressure Test per TAS 203, on Exterior Steel Insulated Wall Panel, prepared by Force Engineering & Testing, Inc., Report No. 438-0239T-15, dated 10/12/2015, signed by Brandon Jasek, P.E.*

**C. CALCULATIONS**

1. *Calculations, 10 pages, prepared by Brian N. Jaks, P.E., dated October 13, 2014, signed and sealed by Brian N. Jaks, P.E., on October 13, 2014.*

**D. QUALITY ASSURANCE**

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

**E. MATERIAL CERTIFICATIONS**

1. *Tensile Test Data issued by Metallurgical Engineering Services, Inc., for **Interior Skin**, dated October 27, 2015, with mechanical properties of Sheet Steel.*
2. *Tensile Test Data issued by Metallurgical Engineering Services, Inc., for **Exterior Skin**, dated October 27, 2015, with mechanical properties of Sheet Steel.*
3. *Accelerated Weathering 2000 hours per ASTM D 659, Humidity test 1000 hours per ASTM D 1654, Salt Spray test per ASTM D 1654.*


**2. NEW EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. *Drawing No. 438-0086T-13, titled "IWP Series", sheets 1 through 14 of 14, prepared by Brian N. Jaks, P.E., dated April 11, 2019, signed and sealed by Brian N. Jaks, P.E., on April 12, 2019.*

**B. TESTS**

1. *None.*



**Helmy A. Makar, P.E., M.S.**  
**Product Control Section Supervisor**

**NOA No. 19-0417.03**

**Expiration Date: 01/14/2021**

**Approval Date: 05/16/2019**

**Green-Span Profiles, L.P.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**C. CALCULATIONS**


1. *None.*

**D. QUALITY ASSURANCE**

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

**E. MATERIAL CERTIFICATIONS**

1. *None.*



---

**Helmy A. Makar, P.E., M.S.**  
**Product Control Section Supervisor**

**NOA No. 19-0417.03**

**Expiration Date: 01/14/2021**

**Approval Date: 05/16/2019**

---

# Approval Document for Miami-Dade Notice of Acceptance


---

*Applicant: Green-Span Profiles, LP*  
*Category: Panels*  
*Subcategory: Wall*  
*Material: Composite*  
*Description: IWP Series (Insulated Wall Panels)*  
*Interior/Exterior Material: Steel*  
*Core Material: Polyisocyanurate Foam*

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 19-0417.03  
Expiration Date 01/14/2021  
By Hedy A. Nebr  
Miami Dade Product Control

RECEIVED  
APR 16 2019

R.E.R.  
Product Control Section

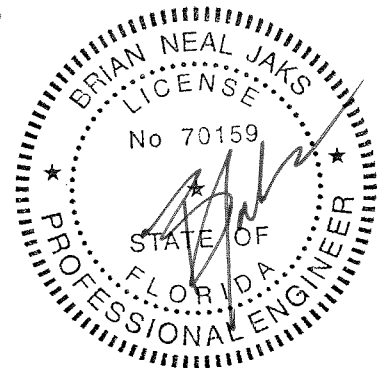

APR 12 2019



1. Compliance Statement – The product as described in this document demonstrated compliance with the Florida Building Code 2017, HVHZ.
2. Product Description – Wall panel system with an interior and exterior steel facing bonded to an insulating polyisocyanurate foam core. A concealed clip in the interlocking side-joint attaches the wall panels to supports. Structural application.
3. Panel: Green Span’s IWP Series
  - 3.1. Profiles
    - 3.1.1. Mesaline
    - 3.1.2. VeeLine
    - 3.1.3. ShadowLine
    - 3.1.4. WaveLine
    - 3.1.5. Impression
    - 3.1.6. Stucco
    - 3.1.7. Infinity
  - 3.2. Thicknesses
    - 3.2.1. 2”
    - 3.2.2. 2.5”
    - 3.2.3. 3”
    - 3.2.4. 4”
    - 3.2.5. 5”
    - 3.2.6. 6”
  - 3.3. Widths: 42” maximum
  - 3.4. Side-joint: Green-Lock, interlocking double tongue-and-groove joint
  - 3.5. Materials
    - 3.5.1. Metal Facings
      - 3.5.1.1. Steel, ASTM A792 Galvalume coated or ASTM A653 G90 galvanized
      - 3.5.1.2. 50-ksi min. yield
      - 3.5.1.3. 26-ga. min
      - 3.5.1.4. Embossed or smooth finish
    - 3.5.2. Core
      - 3.5.2.1. Polyisocyanurate (PIR) insulating foam
      - 3.5.2.2. Huntsman Rubitherm WR 40618 / Rubinate 1850
      - 3.5.2.3. Non-ozone depleting blowing agent
      - 3.5.2.4. Nominal 2.25-pcf apparent density
    - 3.5.3. Concealed Clip
      - 3.5.3.1. Corrosion resistant G90 galvanized steel
      - 3.5.3.2. 14 gauge thickness
      - 3.5.3.3. 1 7/16” x 4” with (5) pre-punched holes
    - 3.5.4. Clip Fastener
      - 3.5.4.1. (2) ¼-14 self-driller, corrosion resistant
    - 3.5.5. Panel Fastener
      - 3.5.5.1. (3) 10-12 Fab-Lok

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 Acceptance No 19-0417.03  
 Expiration Date 01/14/2021  
 By Heg A. Mc  
 Miami Dade Product Control



4. Substrate:
  - 4.1. 14-ga. minimum thickness
  - 4.2. Spaced at maximum 5'-0" on center
  
5. Performance
  - 5.1. TAS 201
    - 5.1.1. Large Missile Impact
    - 5.1.2. Passed
  - 5.2. TAS 203
    - 5.2.1. Cyclic Wind Pressure
    - 5.2.2. Passed
  - 5.3. TAS 202
    - 5.3.1. Design Wind Load
      - 5.3.1.1. Positive: +75-psf
      - 5.3.1.2. Negative: -75-psf
    - 5.3.2. Air Infiltration – passed
    - 5.3.3. Water Infiltration – passed
  - 5.4. ASTM E-84
    - 5.4.1. Flame Spread < 25
    - 5.4.2. Passed
    - 5.4.3. Smoke Developed < 450
    - 5.4.4. Passed
  - 5.5. ASTM D 3361
    - 5.5.1. Accelerated Weathering for 2000 hours
    - 5.5.2. Passed
  - 5.6. ASTM B 117
    - 5.6.1. Salt Spray for 1000 hours
    - 5.6.2. Passed
  
6. Identification: Each panel shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved."
  
7. Installation: per manufacturer's instructions and in compliance with attached drawings
  
8. Limitations of Use
  - 8.1. Panel supports shall be 14-ga. minimum thickness
  - 8.2. Supports shall be spaced at maximum 5'-0" on center
  - 8.3. Minimum (2) fasteners per clip
  - 8.4. Minimum (3) Fabloks installed at 10.5" on center along the interior panel face
  - 8.5. Panels shall not be used as axial or shear components.

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No 19-0417.03  
 Expiration Date 01/14/2021  
 By H. A. Mohr  
 Miami Dade Product Control

RECEIVED  
 APR 16 2019  
 R.E.R.  
 Product Control Section




9. Approved Quality Assurance Entity – Factory Mutual

10. Reference Documents


- 10.1. Force Engineering & Testing Report No. 438-0086T-13, dated 12-9-2013
  - 10.1.1. TAS 201
  - 10.1.2. TAS 202
  - 10.1.3. TAS 203
- 10.2. Factory Mutual Approvals, Project ID: 3044381, dated 11-21-2012
  - 10.2.1. ASTM E84

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 19-0417.03  
Expiration Date 01/14/2021  
By H. G. A. McW  
Miami Dade Product Control

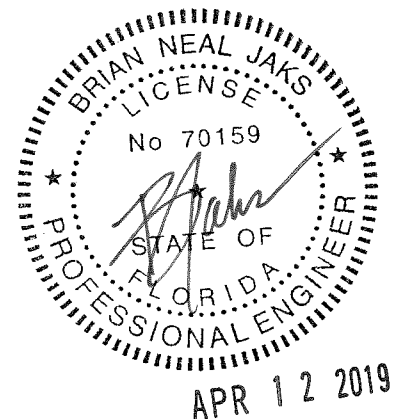



DIM 'A' = 2", 2.5", 3", 4", 5", or 6"

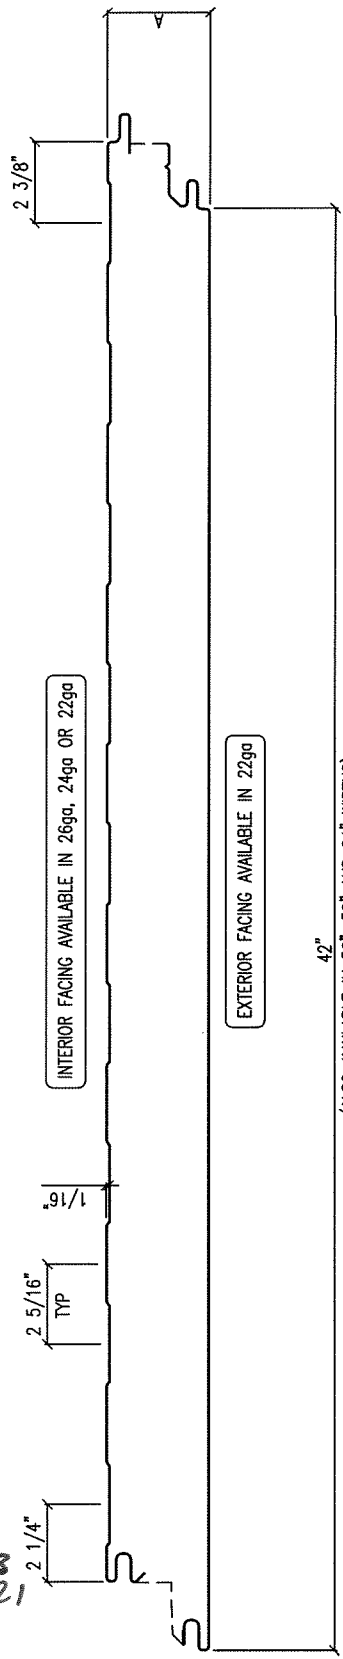


INTERIOR FACING AVAILABLE IN 26ga, 24ga OR 22ga

EXTERIOR FACING AVAILABLE IN 22ga


(ALSO AVAILABLE IN 36", 30" AND 24" WIDTHS)

EXTERIOR FACING HAS A HEAVILY EMBOSSED TEXTURE

PRODUCT REVISED as complying with the Florida Building Code  
Acceptance No 19-0417.03  
Expiration Date 01/14/2021  
By *Heidi A. Miller*  
Miami Dept Product Control

 <b>GREEN SPAN PROFILES</b> <small>INSULATED PANEL TECHNOLOGIES</small>	
<b>IMPRESSION</b>	
PROFILE:	DATE: 1-10-12
DRAWING NO:	SCALE: NONE
CHECKS:	APPROVED:
DATE:	DATE:


REVISIONS	DATE
1-14-12	

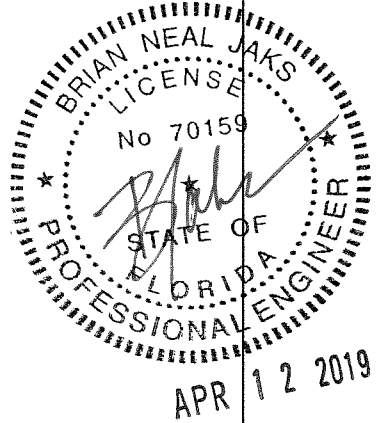





DIM 'A' = 2", 2.5", 3", 4", 5", or 6"

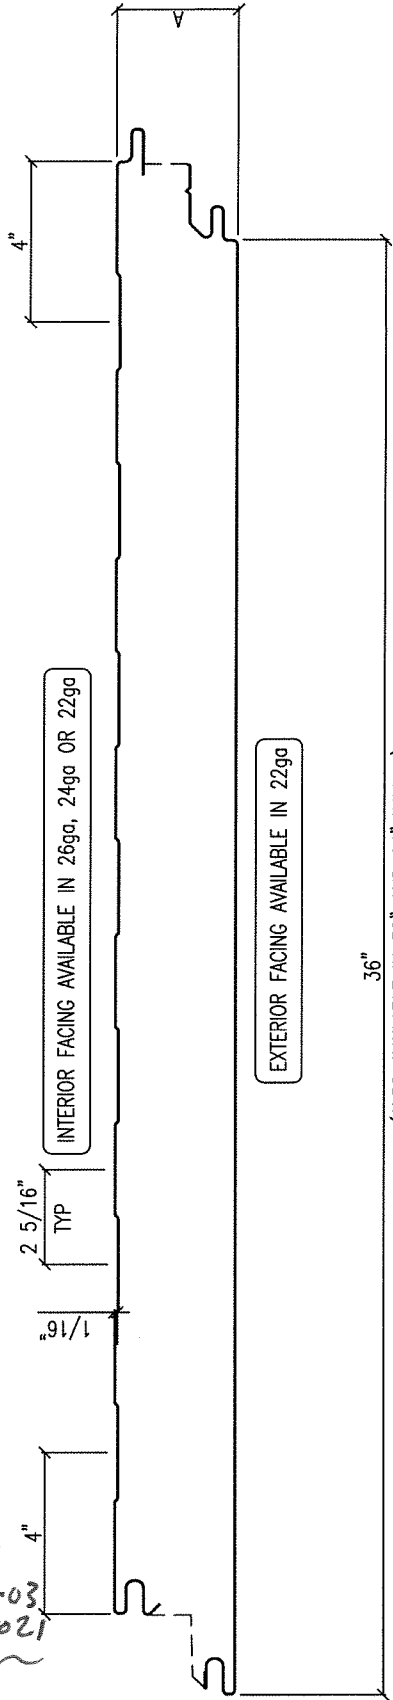

INTERIOR FACING AVAILABLE IN 26ga, 24ga OR 22ga

EXTERIOR FACING AVAILABLE IN 22ga


(ALSO AVAILABLE IN 30" AND 24" WIDTHS)

EXTERIOR FACING IS SMOOTH

PRODUCT REVISED as complying with the Florida Building Code Acceptance No 19-0417-03 Expiration Date 01/14/2021 By *Hely A. Miller* Miami Dept Product Control


 <b>GREEN SPAN PROFILES</b> <small>INSULATED PANEL TECHNOLOGIES</small>	
PROFILE:	INFINITY
DATE:	1-10-12
DRAWN BY:	DC
SCALE:	NONE
CHECKED:	
APPROVED:	
DATE:	

NO.	REVISIONS	DATE
1	ISSUED	4-18-12

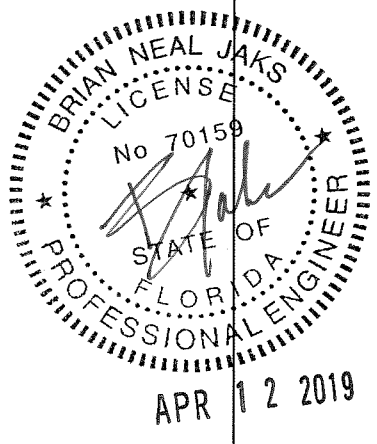



DIM 'A' = 2", 2.5", 3", 4", 5", or 6"

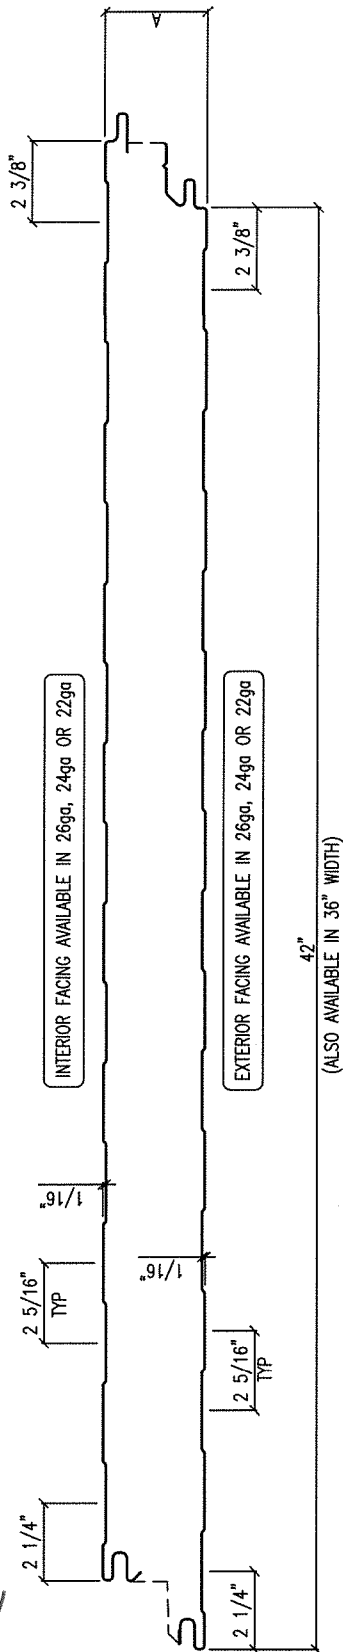


INTERIOR FACING AVAILABLE IN 26ga, 24ga OR 22ga

EXTERIOR FACING AVAILABLE IN 26ga, 24ga OR 22ga

42" (ALSO AVAILABLE IN 36" WIDTH)

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No 19-0417.03  
 Expiration Date 01/14/2021  
 By Hedy A. McLean  
 Miami Dade Product Control




PROFILE:	MESALINE
DATE:	1-10-12
DRAWN BY:	
SCALE:	1/8" = 1'
CHECKED:	
APPROVED:	
DATE:	

REVISIONS	DATE	DESCRIPTION
1	4-12-12	






DIM 'A' = 2", 2.5", 3", 4", 5", or 6"

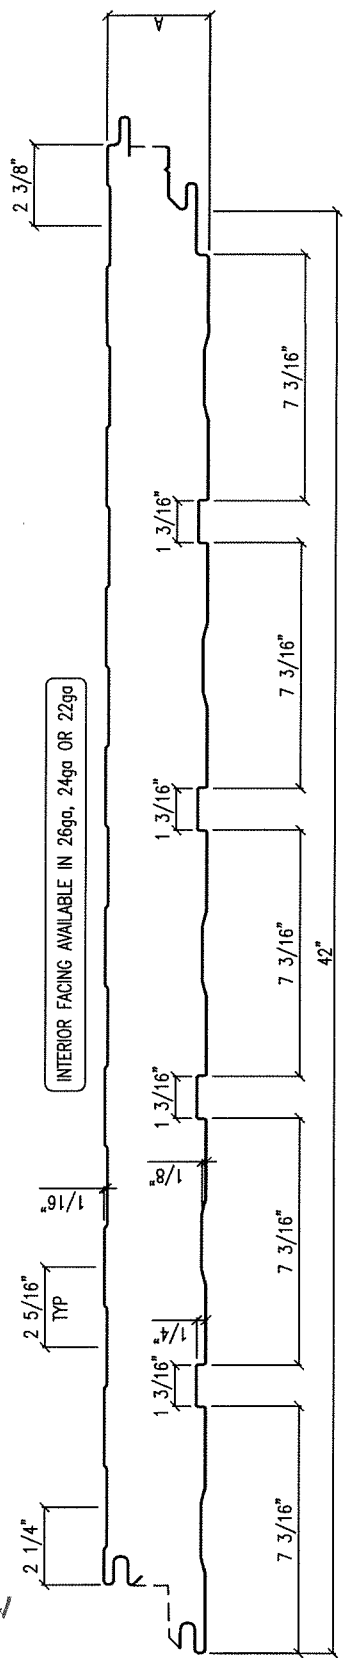

INTERIOR FACING AVAILABLE IN 26ga, 24ga OR 22ga

EXTERIOR FACING AVAILABLE IN 26ga, 24ga OR 22ga

PRODUCT REVISED as complying with the Florida Building Code  
Acceptance No 19-0417.03  
Expiration Date 01/14/2021  
By *Hugh A. Moran*  
Miami Data Product Control




PROFILE: SHADOWLINE  
DATE: 1-10-12  
DRAWN: DG  
SCALE: NONE  
CHECKED:  
APPROVED:  
DATE:

DATE	DESCRIPTION





DIM 'A' = 2", 2.5", 3", 4", 5", or 6"

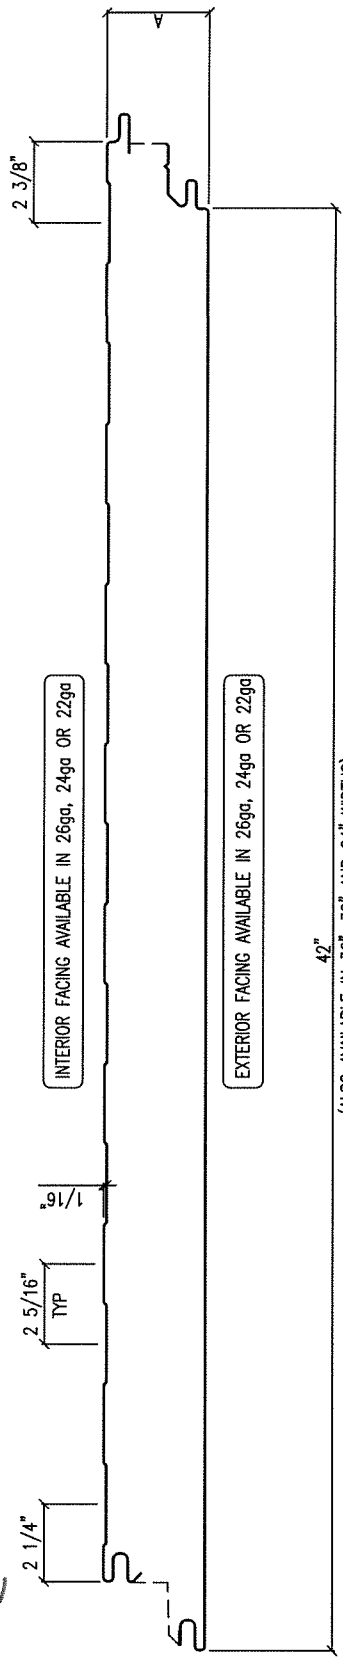

INTERIOR FACING AVAILABLE IN 26ga, 24ga OR 22ga


EXTERIOR FACING AVAILABLE IN 26ga, 24ga OR 22ga

(ALSO AVAILABLE IN 36", 30" AND 24" WIDTHS)

EXTERIOR FACING HAS AN EMBOSSED TEXTURE


PRODUCT REVISED as complying with the Florida Building Code Acceptance No 19-0417-03 Expiration Date 01/14/2021 By [Signature] Miami Dade Product Control

Table with columns: REVISIONS, PROFILE, STUCCO, DATE, DRAWING DC, SCALE, NAME, APPROVED, DATE. Includes Green Span Profiles logo and 'INSULATED PANEL TECHNOLOGIES'.

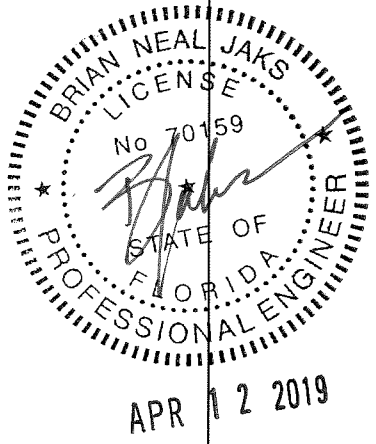



DIM 'A' = 2", 2.5", 3", 4", 5", or 6"

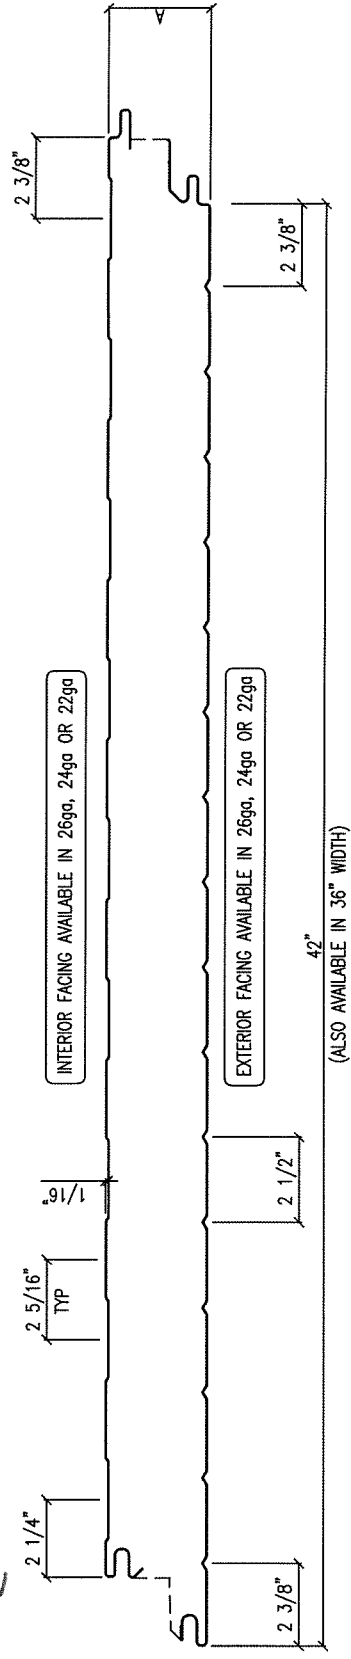

INTERIOR FACING AVAILABLE IN 26ga, 24ga OR 22ga

EXTERIOR FACING AVAILABLE IN 26ga, 24ga OR 22ga


(ALSO AVAILABLE IN 36" WIDTH)

PRODUCT REVISED as complying with the Florida Building Code Acceptance No 19-0417.03 Expiration Date 01/14/2021 By Healy A. Mc... Miami Data Product Control




PROFILE: VEELINE DATE: 1-10-12 DRAWN: DS SCALE: NONE CHECKS: APPROVED: DATE:

Table with columns: REVISIONS, DATE, DESCRIPTION

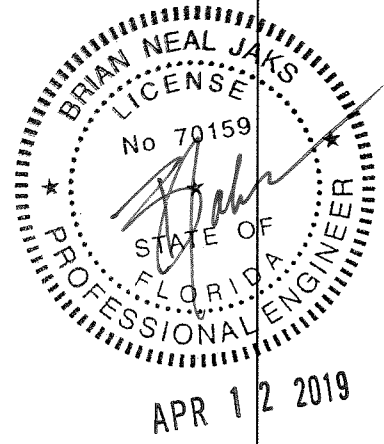



DIM. 'A' = 2", 2.5", 3", 4", 5", or 6"

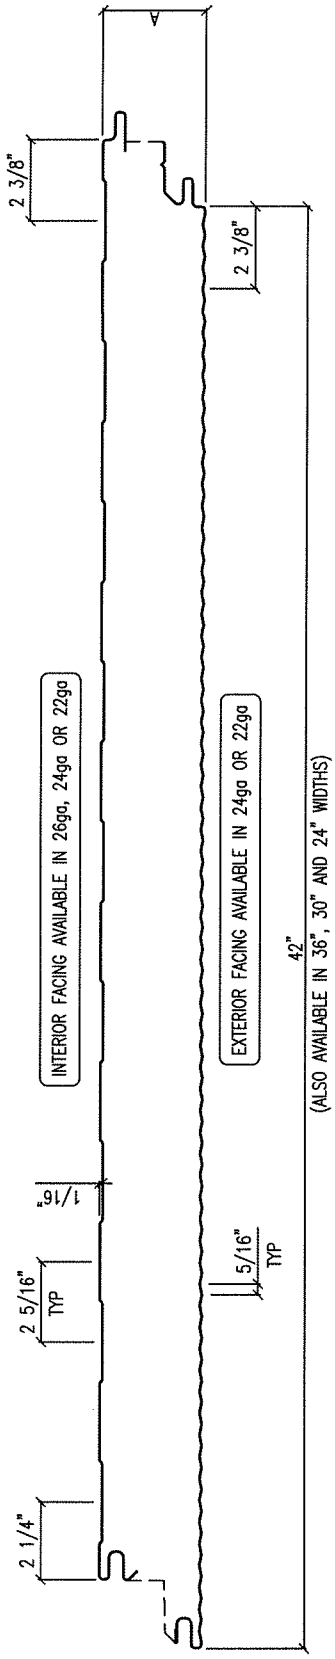


INTERIOR FACING AVAILABLE IN 26ga, 24ga OR 22ga

EXTERIOR FACING AVAILABLE IN 24ga OR 22ga


(ALSO AVAILABLE IN 36", 30" AND 24" WIDTHS)


PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 19-0417.03 Expiration Date 01/14/2021 By Heg A. Mah Miami Dade Product Control



WAVELINE PROFILE: DATE: 1-10-12 DRAWN: JDC SCALE: NONE CHECKED: APPROVED: DATE:

Table with columns: REVISIONS, DATE, DESCRIPTION

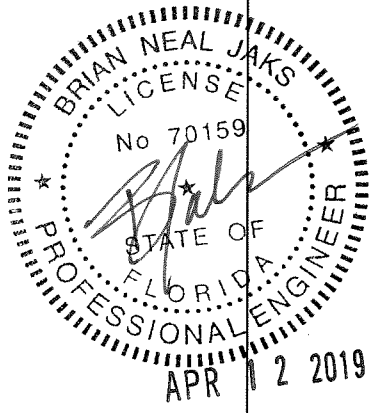


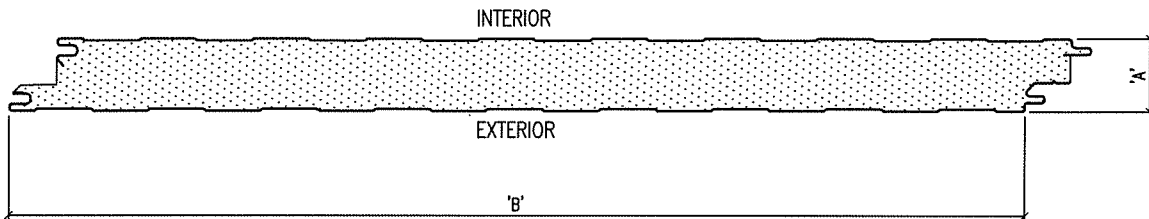

GENERAL PANEL PROFILE  
MIN. 26-GA.

DIM 'A' = 2", 2.5", 3", 4", 5", or 6"


DIM 'B' = 42", 36", 30" OR 24"

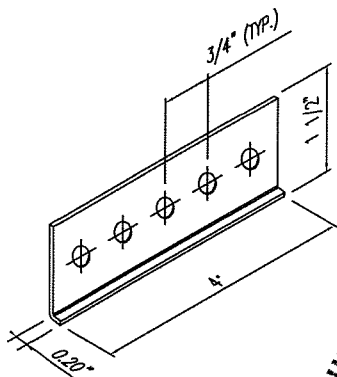


WALL PANEL CLIP [AC-01]  
14GA. (0.070") MIN.



1/4-14 X TEK3 SDS FASTENER




FAB-LOK FASTENER

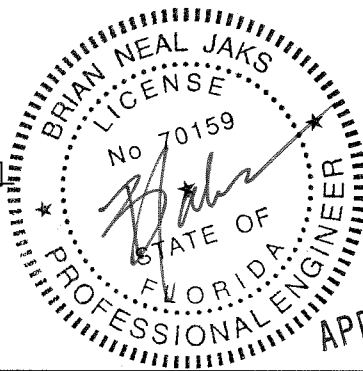


PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 19-0417-03  
Expiration Date 01/14/2021  
By *H. G. A. M. M.*  
Miami Data Product Control

MANUFACTURED BY:

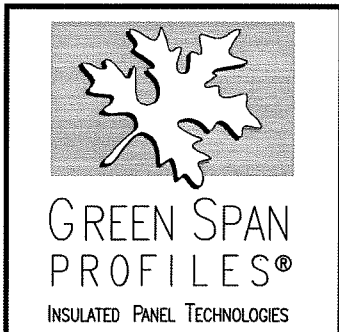


SECTIONS WITH DIMENSIONS AND THICKNESSES



DATE: MARCH 19, 2004	NOTES: CHECK LIST SECTION 'A'
PAGE: 1 OF 3	PRODUCT NAME: IWP SERIES
REVISION: NONE	DOCUMENT NUMBER: 438-0086T-13
PREPARED BY: BRIAN N. JAKS, FLPE #70159	
21200 FM362, WALLER, TEXAS 77484	281-807-7400 WWW.GREENSPANPROFILES.COM

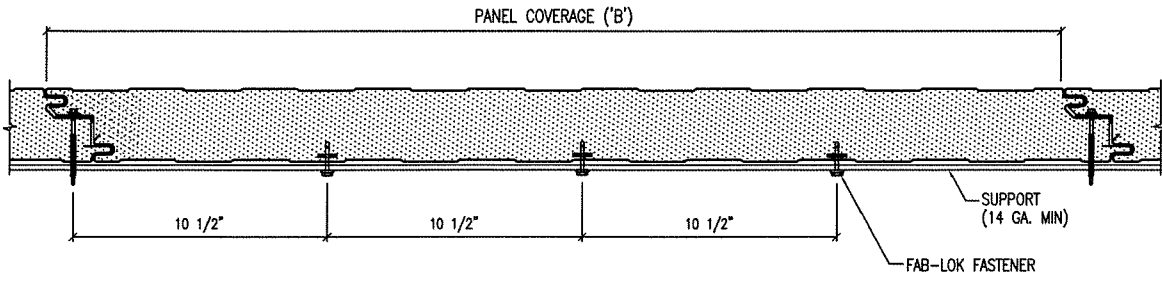


SECTION 'A'-'A': TYPICAL FASTENER PATTERN DIAGRAM

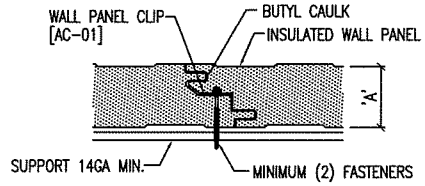

SECTION 'B'-'B': PANEL SIDELAP FASTENING

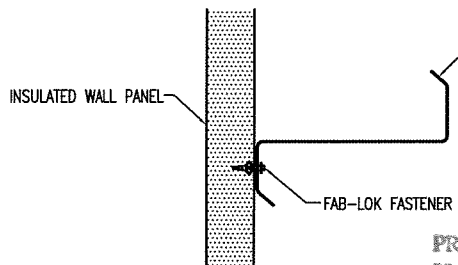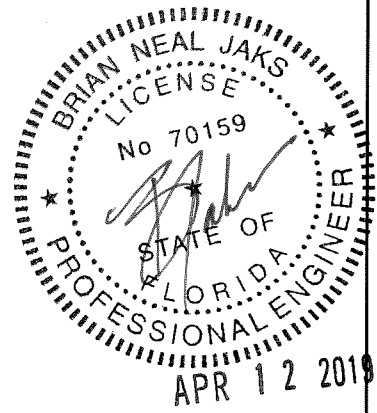


DETAIL 'C': PANEL CONNECTION

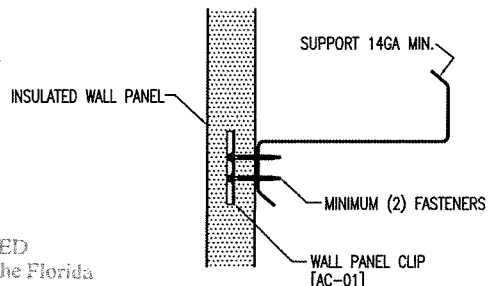

DETAIL 'D': PANEL CONNECTION


PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 19-0417-03  
 Expiration Date 01/14/2021  
 By *[Signature]*  
 Miami Dad Product Control

MANUFACTURED BY:

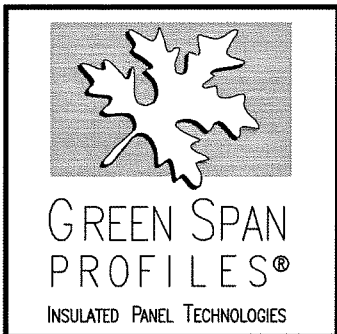


ASSEMBLY DETAILS WITH CONNECTIONS		
DATE: MARCH 19, 2004	NOTES: CHECK LIST SECTION 'B'	
PAGE: 2 OF 3	PRODUCT NAME: IWP SERIES	
REVISION: NONE	DOCUMENT NUMBER: 438-0086T-13	
PREPARED BY: BRIAN N. JAKS, FLPE #70159		
21200 FM362, WALLER, TEXAS 77484	281-807-7400	WWW.GREENSPANPROFILES.COM



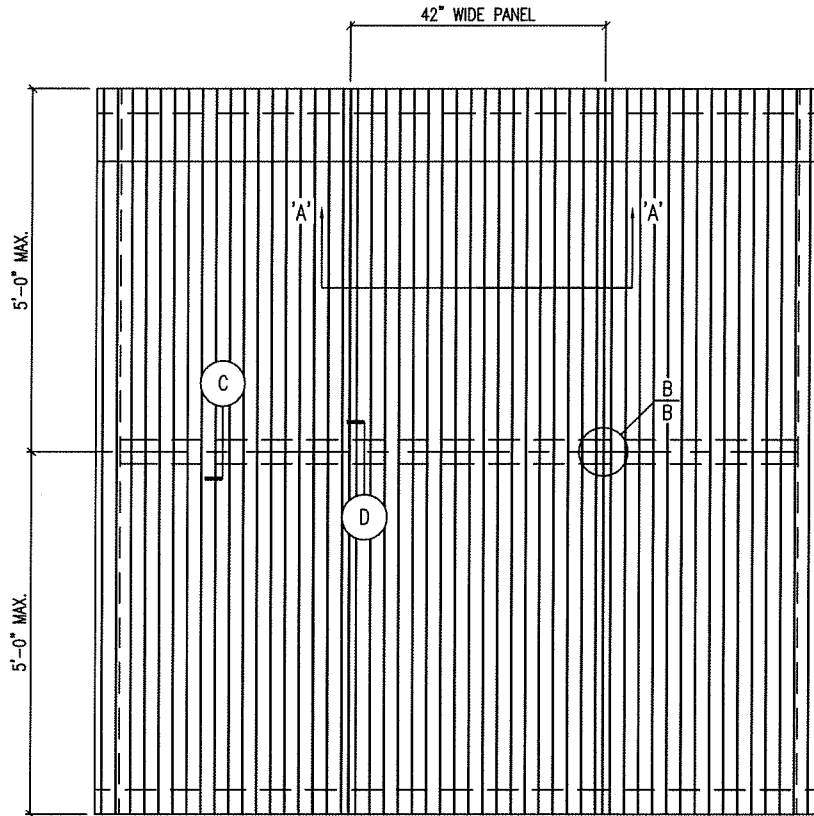


TYPICAL EXTERIOR WALL ELEVATION

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No 19-0417.03  
 Expiration Date 01/14/2021  
 By [Signature]  
 Miami Dade Product Control

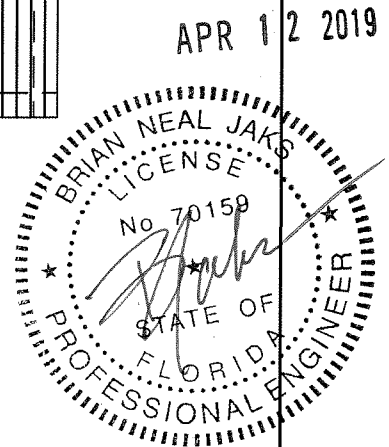

MANUFACTURED BY:

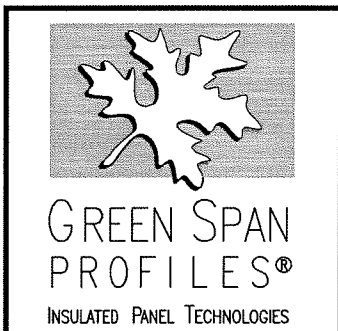

TYPICAL FASTENING DIAGRAMS

DATE: MARCH 19, 2004	NOTES: CHECK LIST SECTION 'C'
PAGE: 3 OF 3	PRODUCT NAME: IWP SERIES
REVISION: NONE	DOCUMENT NUMBER: 438-0086T-13
PREPARED BY: BRIAN N. JAKS, FLPE #70159	
21200 FM362, WALLER, TEXAS 77484	281-807-7400 WWW.GREENSPANPROFILES.COM